



SIDEWALK SPECIFICATIONS

- A. Must conform in size with existing sidewalks
- B. Must have at least four inches (4") of Class B concrete, with twenty-eight (28) day compressive strength of three thousand seven hundred fifty (3750) PSI (minimum)
- C. There must be at least six inches (6") of compacted gravel that is free from organic gravel on a stable compacted grade.
- D. Must have transverse expansion joints one half inch ($\frac{1}{2}$ ") wide provided at twenty foot (20') maximum intervals. Expansion joints shall be filled with material type as per latest NYCDOT specifications (closed cell polyethylene, pre-molded Bituminous, or approved equal) score
- E. Sidewalks over driveways shall be the same requirements except the concrete shall be a minimum of seven inches (7")

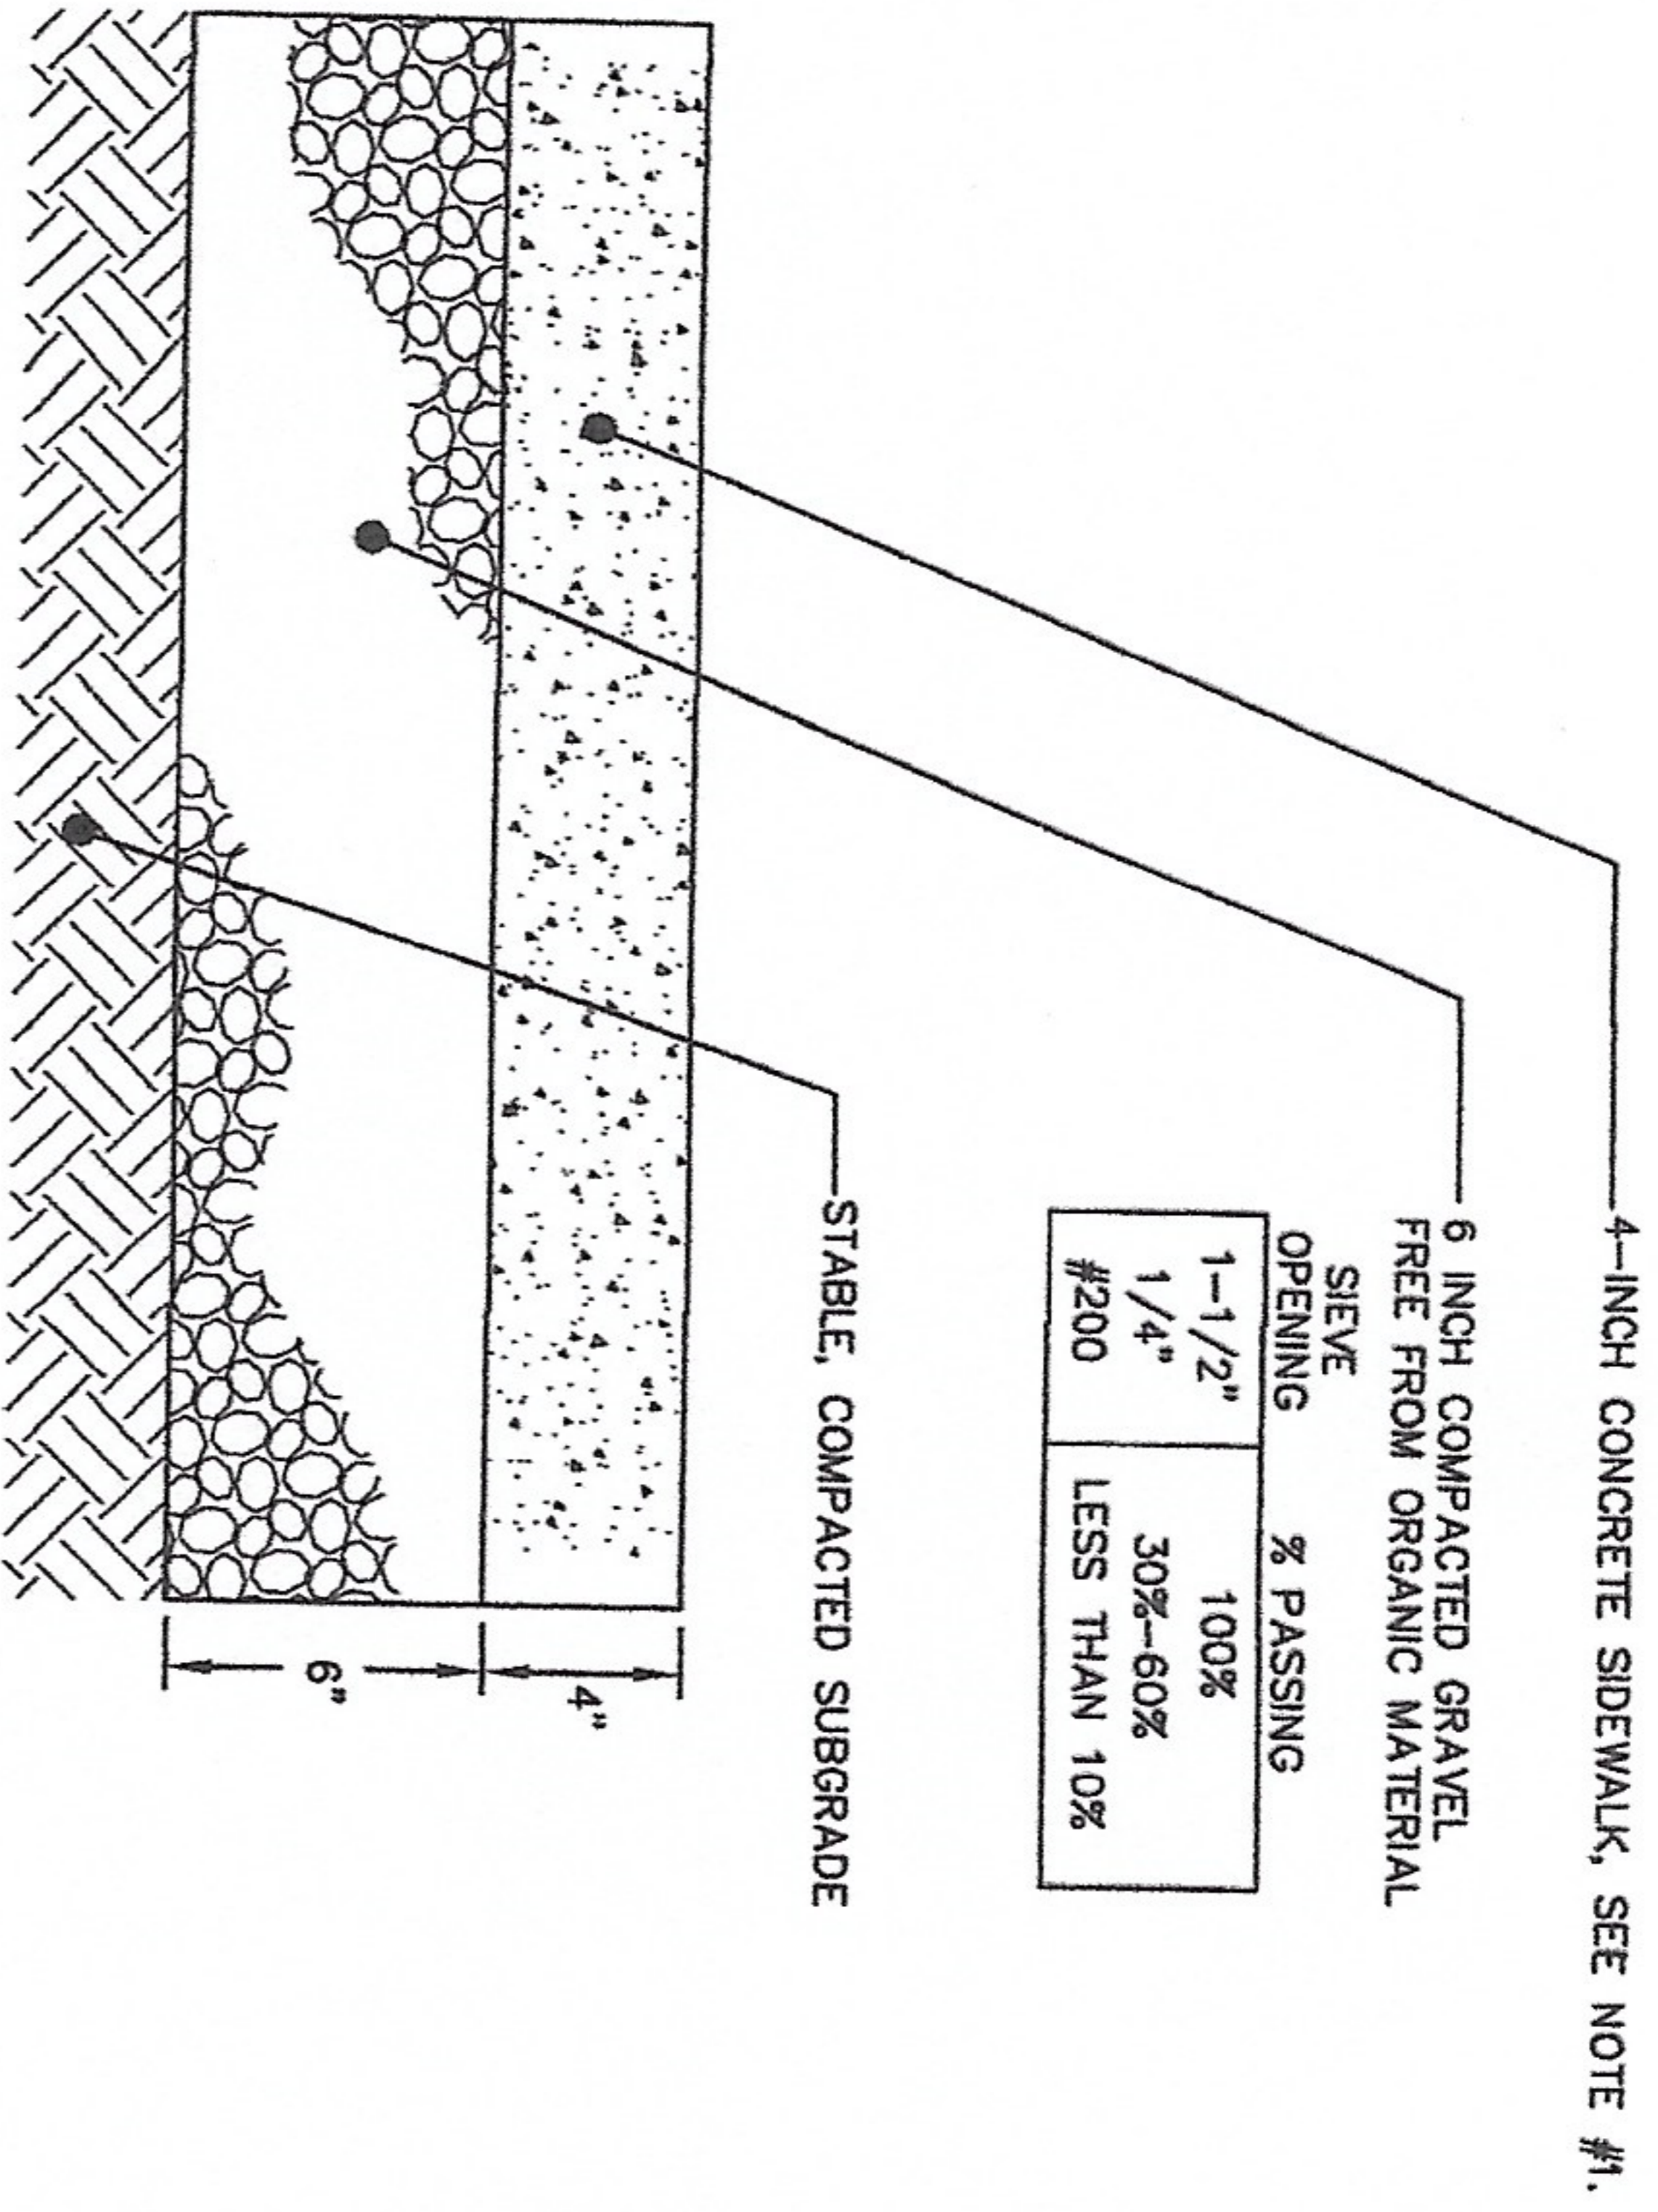

- NOTES:
1. CONCRETE SHALL BE CLASS B, WITH A 28-DAY COMPRESSIVE STRENGTH OF 3,750 PSI (MIN.)
 2. TRANSVERSE EXPANSION JOINTS (1/2-INCH WIDE SHALL BE PROVIDED AT 20-FOOT MAXIMUM INTERVALS. EXPANSION JOINTS SHALL BE FILLED WITH MATERIAL TYPE AS PER LATEST NYCDOT SPECIFICATION (CLOSED CELL POLYETHYLENE, PREMOLDED BITUMINOUS, OR APPROVED EQUAL) SCORE LINES SHALL BE EVERY 5-FEET O.C.

1 STANDARD CONCRETE SIDEWALK
NTS

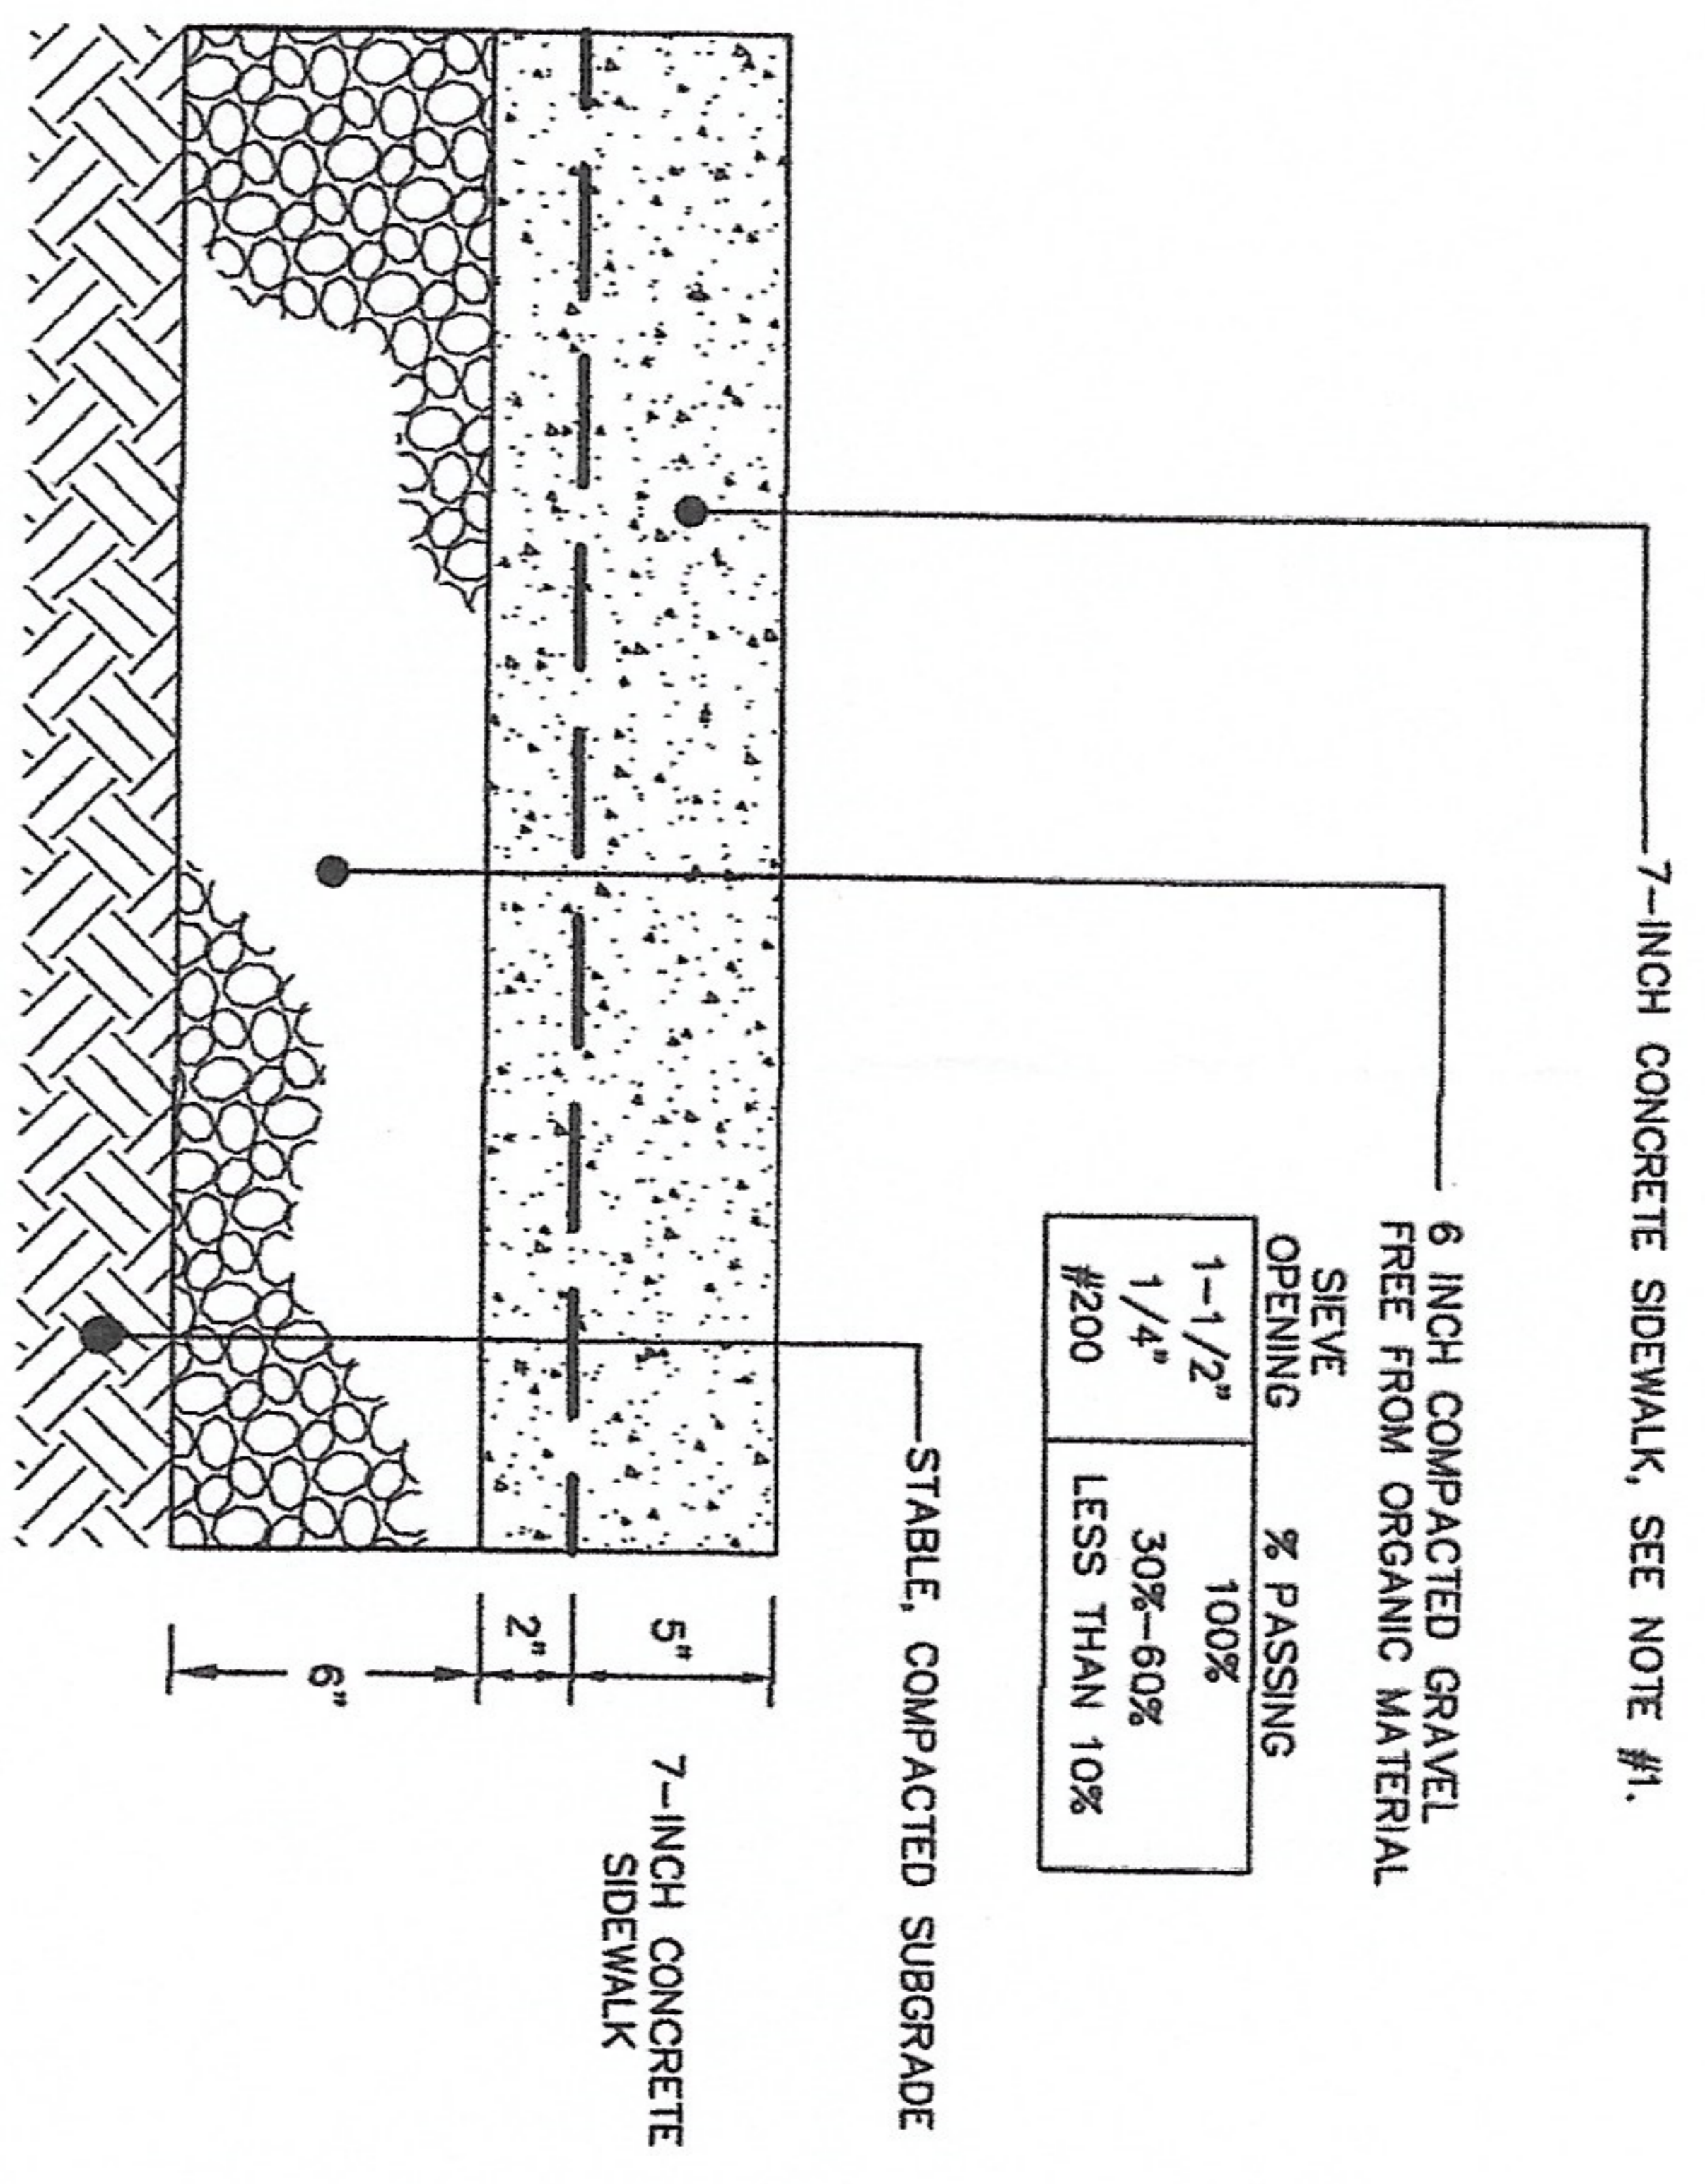

- NOTES:
1. CONCRETE SHALL BE CLASS B WITH A 28-DAY COMPRESSIVE STRENGTH OF 3,750 PSI (MIN.)

2 CONCRETE SIDEWALK AT DRIVEWAYS
NTS

DRAWING TITLE:		
CONCRETE SIDEWALK SECTIONS		
DATE: 6/3/13	SCALE: NTS	DRAWING #: